

6980 Sierra Center Parkway, Suite 90
 Reno, NV 89511

August 10, 2011
 File: 1009

Mr. Chris Benna
RILITE AGGREGATES
 3025 Mill Street
 Reno, NV 89502

RE: Rilite Pit - Class C Backfill (¾-Inch Drain Rock)

Dear Mr. Benna:

Per your request, we have performed testing on the Class C Backfill delivered to our laboratory on August 3rd. Test results in comparison with local standard specifications are as follows:


Sieve Size Analysis (ASTM C136/C117)		
U.S. Standard Sieve Size	Percent By Weight Passing	
	Rilite Pit	Local Standard Specification*
1 Inch	100	100
¾ Inch	99	90 - 100
½ Inch	40	-
⅜ Inch	15	10 - 55
No. 4	2	0 - 10
No. 8	1	-
No. 200	0.4	-
Clay Lumps and Friable Particles (ASTM C142)		
Percent of Total Sample	0.0%	
Los Angeles Abrasion (ASTM C131)		
Percentage of Wear (500 Revolutions)	Local Standard Specification*	
30.5%	37% Maximum	

* Standard Specifications for Public Works Construction (Washoe County, Sparks, Reno, Carson City and Douglas County), 2007.

We appreciate this opportunity to provide our laboratory testing services. If you have any questions or require further information, please do not hesitate to contact us.

Sincerely,

CONSTRUCTION MATERIALS ENGINEERS, INC.

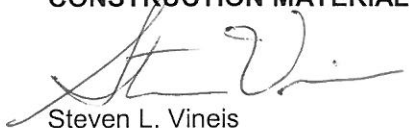

Steven L. Vineis
 Laboratory Manager
svineis@cme-corp.com
 Direct: 775-737-7568
 Direct Fax: 775-737-7605
 Mobile: 775-772-9921

Jon A. Del Santo, PE
 Project Manager
 RE Number 17094
 Expiration Date 12-31-12 CIVIL
jdel santo@cme-corp.com
 Direct: 775-737-7564
 Direct Fax: 775-737-7602
 Mobile: 775-846-4399



SLV:JAD:jwl
 v:\active\1009\2011\class_c_backfill_08-10-11.doc