

6980 Sierra Center Parkway, Suite 90
Reno, NV 89511

August 18, 2017
File: 1009

Mr. Chris Benna
RILITE AGGREGATES
3025 Mill Street
Reno, NV 89502

RE: Rilite Pit - Class C Backfill (¾-Inch Drain Rock)

Dear Mr. Benna:

Per your request, we have performed testing on the Class C Backfill delivered to our laboratory on August 10th. Test results in comparison with local standard specifications are as follows:

Sieve Size Analysis (ASTM C136/C117)		
U.S. Standard Sieve Size	Percent By Weight Passing	
	Rilite Pit	Local Standard Specification*
1 Inch	100	100
¾ Inch	93	90 - 100
½ Inch	52	-
⅜ Inch	15	10 - 55
No. 4	3	0 - 10
No. 8	2	-
No. 200	1.1	-

Clay Lumps and Friable Particles (ASTM C142)	
Percent of Total Sample	0.8%

Los Angeles Abrasion (ASTM C131)	
Percentage of Wear (500 Revolutions)	Local Standard Specification*
37.6%	37% Maximum

*Standard Specifications for Public Works Construction (Washoe County, Sparks, Reno, Carson City and Douglas County), 2012.

We appreciate this opportunity to provide our laboratory testing services. If you have any questions or require further information, please do not hesitate to contact us.


Sincerely,

CONSTRUCTION MATERIALS ENGINEERS, INC.

Kate B. Weigel FOR

Steven L. Vineis
Laboratory Manager
svineis@cmenv.com
Direct: 775-737-7568
Mobile: 775-772-9921

Roger O. Corkill Jr., PE
Project Manager
RE Number 19868
Expiration Date 12-31-18
rcorkill@cmenv.com
Direct: 775-737-7581
Mobile: 775-722-5067

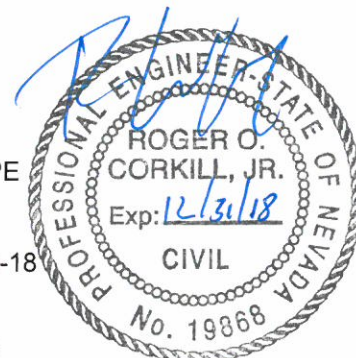

SLV:ROC:roc

v:\active\1009\2017\class_c_backfill_08-18-17.doc